


FLEXCOMP™ Copper Piping System Expansion Compensators



NOTE: FOR PROPER OPERATION, ALL PIPING MUST BE PROPERLY ANCHORED AND GUIDED.

Qty	I.D. (In.)	Length (In.)	Max Pressure (PSI)		Movement Capability		Weight (Lbs.)	Notes
			Working	Test	Compression (In.)	Extension (In.)		
<input type="checkbox"/>	.75	12.500	200	300	1.75	.25	2.20	
<input type="checkbox"/>	1.00	12.500	200	300	1.75	.25	2.40	
<input type="checkbox"/>	1.25	13.812	200	300	1.75	.25	3.10	
<input type="checkbox"/>	1.50	13.812	200	300	1.75	.25	3.30	
<input type="checkbox"/>	2.00	13.812	200	300	1.75	.25	5.50	
<input type="checkbox"/>	2.50	14.435	200	300	1.75	.25	7.50	
<input type="checkbox"/>	3.00	14.435	200	300	1.75	.25	10.00	

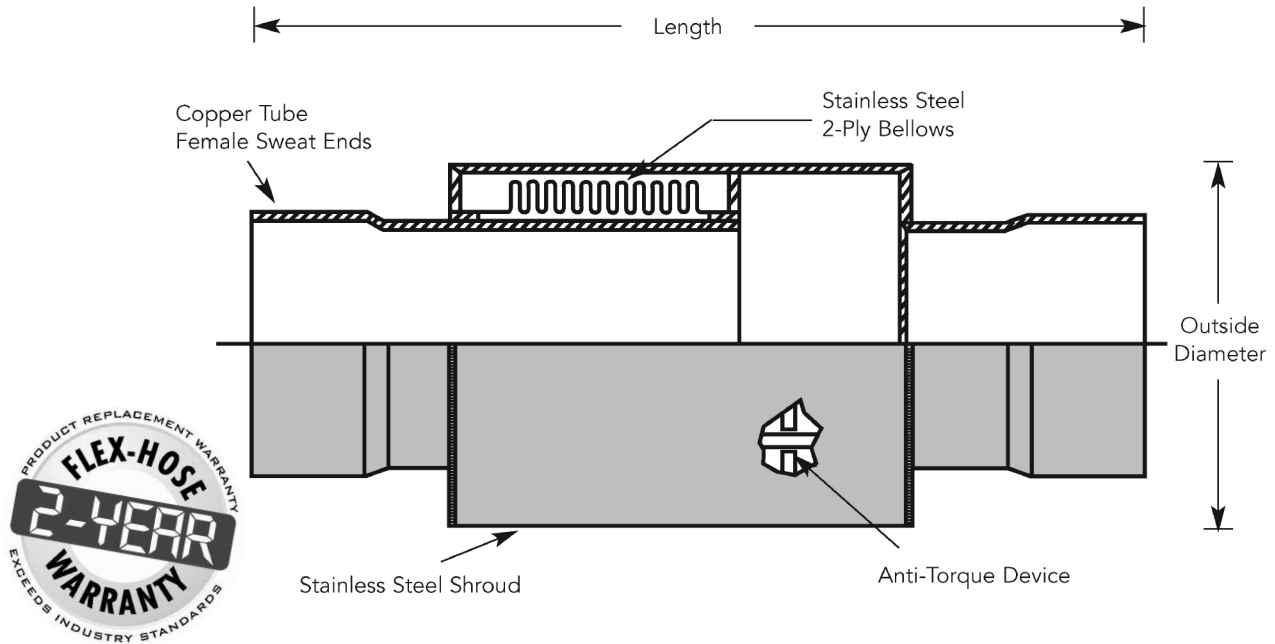

CSA standard B-51 certified. Inspected and tested by the Technical Standards and Safety Authority of Canada.

This product is produced with stainless steel bellows. Stainless steel components should not be used in systems containing excessive chlorides. Premature failure may result.

MAXIMUM SERVICE TEMPERATURE IS 750°F

PROJECT	
CUSTOMER	
ENGINEER	
REPRESENTATIVE	
DRAWING#	



6801 Crossbow Drive
 East Syracuse, NY USA 13057-1026
 315/437-1611 • Fax 315/437-1903
www.flexhose.com • 1.877.METAL EJ

Rev. 201806